

PRODUCT IMAGE

PRODUCT DESCRIPTION

MANUFACTURES PART NUMBER



TYPE 'G'

ANSELL 'GARDIAN'
3W LED (IP65) BULKHEAD
EMERGENCY LIGHT FITTING

AGLED/3M



ANSELL 'CENTURION'
7W LED (IP65) BULKHEAD
EMERGENCY LIGHT FITTING

ACLED/3M/ST



TYPE 'TS'

ANSELL
2x20W LED TWIN-SPOT
EMERGENCY LIGHT FITTING


ATSLED/3NM



TYPE 'MP'

MENVIER MICRPOINT-2 (FLUSH)
1W LED EMERGENCY LIGHT FITTING
(ESCAPE ROUTE)


MP2E3H

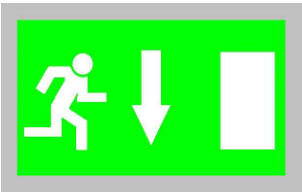

TYPE 'WD'


ANSELL 'WATCHMAN' 3W LED
37m ILLUMINATED EXIT SIGN
(DOWN ARROW)

AWLED/3M

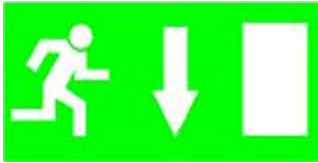


TYPE 'AD'

EXIT LEGEND
(ARROW DOWN)

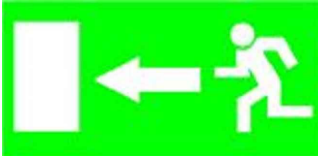

TYPE 'AL'

EXIT LEGEND
(ARROW LEFT)

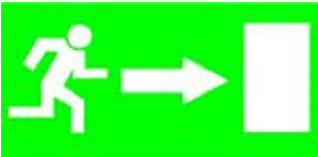

TYPE 'AR'

EXIT LEGEND
(ARROW RIGHT)

Revision	Description	Date	Checked
AMENDMENT RECORD			
© This drawing and/or design is the property of 'LIFE SAFETY SYSTEMS' and shall not be reproduced or copied in the whole or part in any way or conveyed to a third party without the owners written permission.			
Drawing Number: SAMPLE/2016/02/SC001			
Revision:			


- NOTE 1: EXISTING EMERGENCY LIGHT FITTING TO BE ISOLATED AND REMOVED
- NOTE 2: EXISTING EMERGENCY LIGHT FITTING / ILLUMINATED EMERGENCY EXIT SIGN TO BE REPLACED WITH NEW
- NOTE 3: EXISTING ILLUMINATED EXIT SIGN TO BE REPLACED WITH EMERGENCY EXIT SIGN
- NOTE 4: EXISTING EMERGENCY EXIT SIGNAGE TO BE REPLACED WITH ILLUMINATED EMERGENCY EXIT SIGN

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED
DO NOT SCALE FROM THIS DRAWING

A1

© This drawing and/or design is the property of 'LIFE SAFETY SYSTEMS' and shall not be reproduced or copied in the whole or part in any way or conveyed to a third party without the owner's written permission.

NOTES:

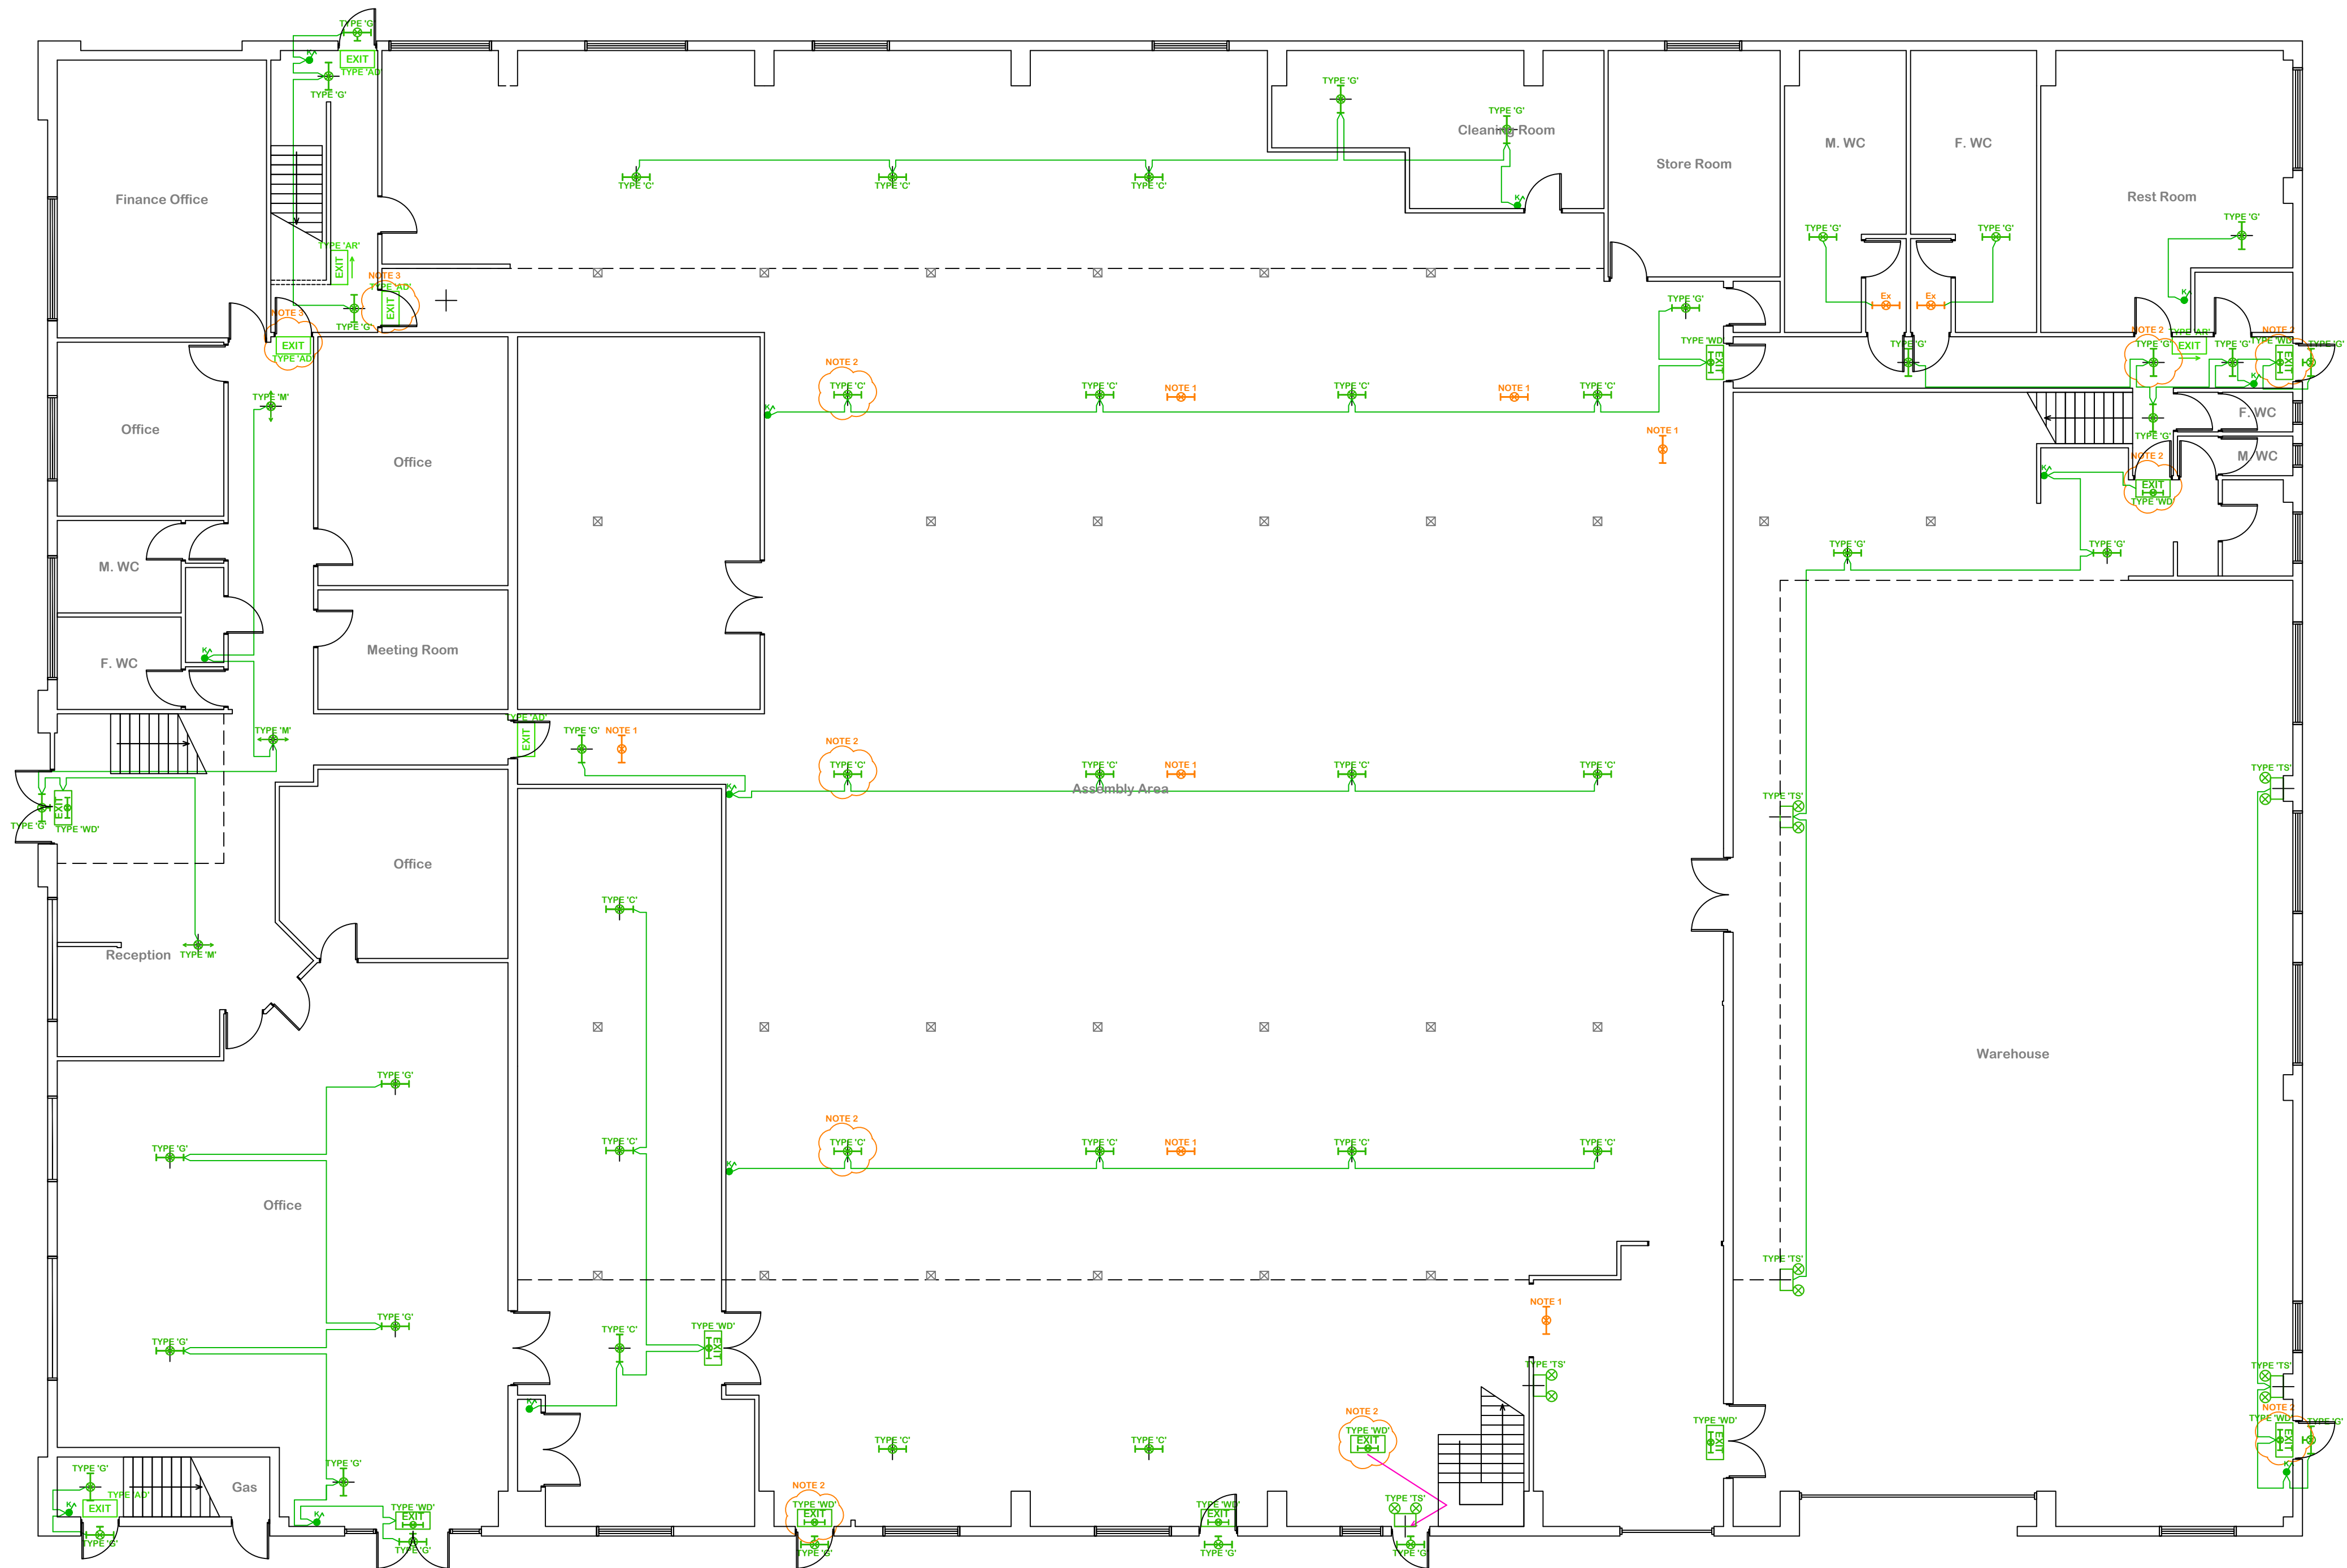

*** WARNING ***

The Emergency Lighting design as detailed on this drawing has been developed to achieve the minimum illumination levels as defined within BS5266:Part 1:2011, independent of the normal mains electricity supply.

The design as depicted, has been based on specific emergency lighting equipment as detailed in the accompanying documentation.

The use of alternative equipment will invalidate the design as shown together with the compliance with the current British Standards.

Revision	Description	Date	Checked
----------	-------------	------	---------

AMENDMENT RECORD



4 HERMITAGE CLOSE THREE LEGGED CROSS
WIMBORNE DORSET BH21 6QA
Tel: 07835 742200
Email: autocad_drawings@btinternet.com

Project:

Test Link Services Ltd
Factory Road
Upton
Poole
Dorset
BH16 5SJ

Title:

Proposed
Emergency Lighting Upgrade
GROUND FLOOR

Drawn By:

ISW

Date:

FEB 16

Checked By:

Date:

Scale @ A1:

1:100

Date:

FEB 16



Drawing Number:

SAMPLE/2016/02/EM100

Revision:

1 2 3 4 5 6 7 8 9 10

- NOTE 1: EXISTING EMERGENCY LIGHT FITTING TO BE ISOLATED AND REMOVED
- NOTE 2: EXISTING EMERGENCY LIGHT FITTING / ILLUMINATED EMERGENCY EXIT SIGN TO BE REPLACED WITH NEW
- NOTE 3: EXISTING ILLUMINATED EXIT SIGN TO BE REPLACED WITH EMERGENCY EXIT SIGN
- NOTE 4: EXISTING EMERGENCY EXIT SIGNAGE TO BE REPLACED WITH ILLUMINATED EMERGENCY EXIT SIGN

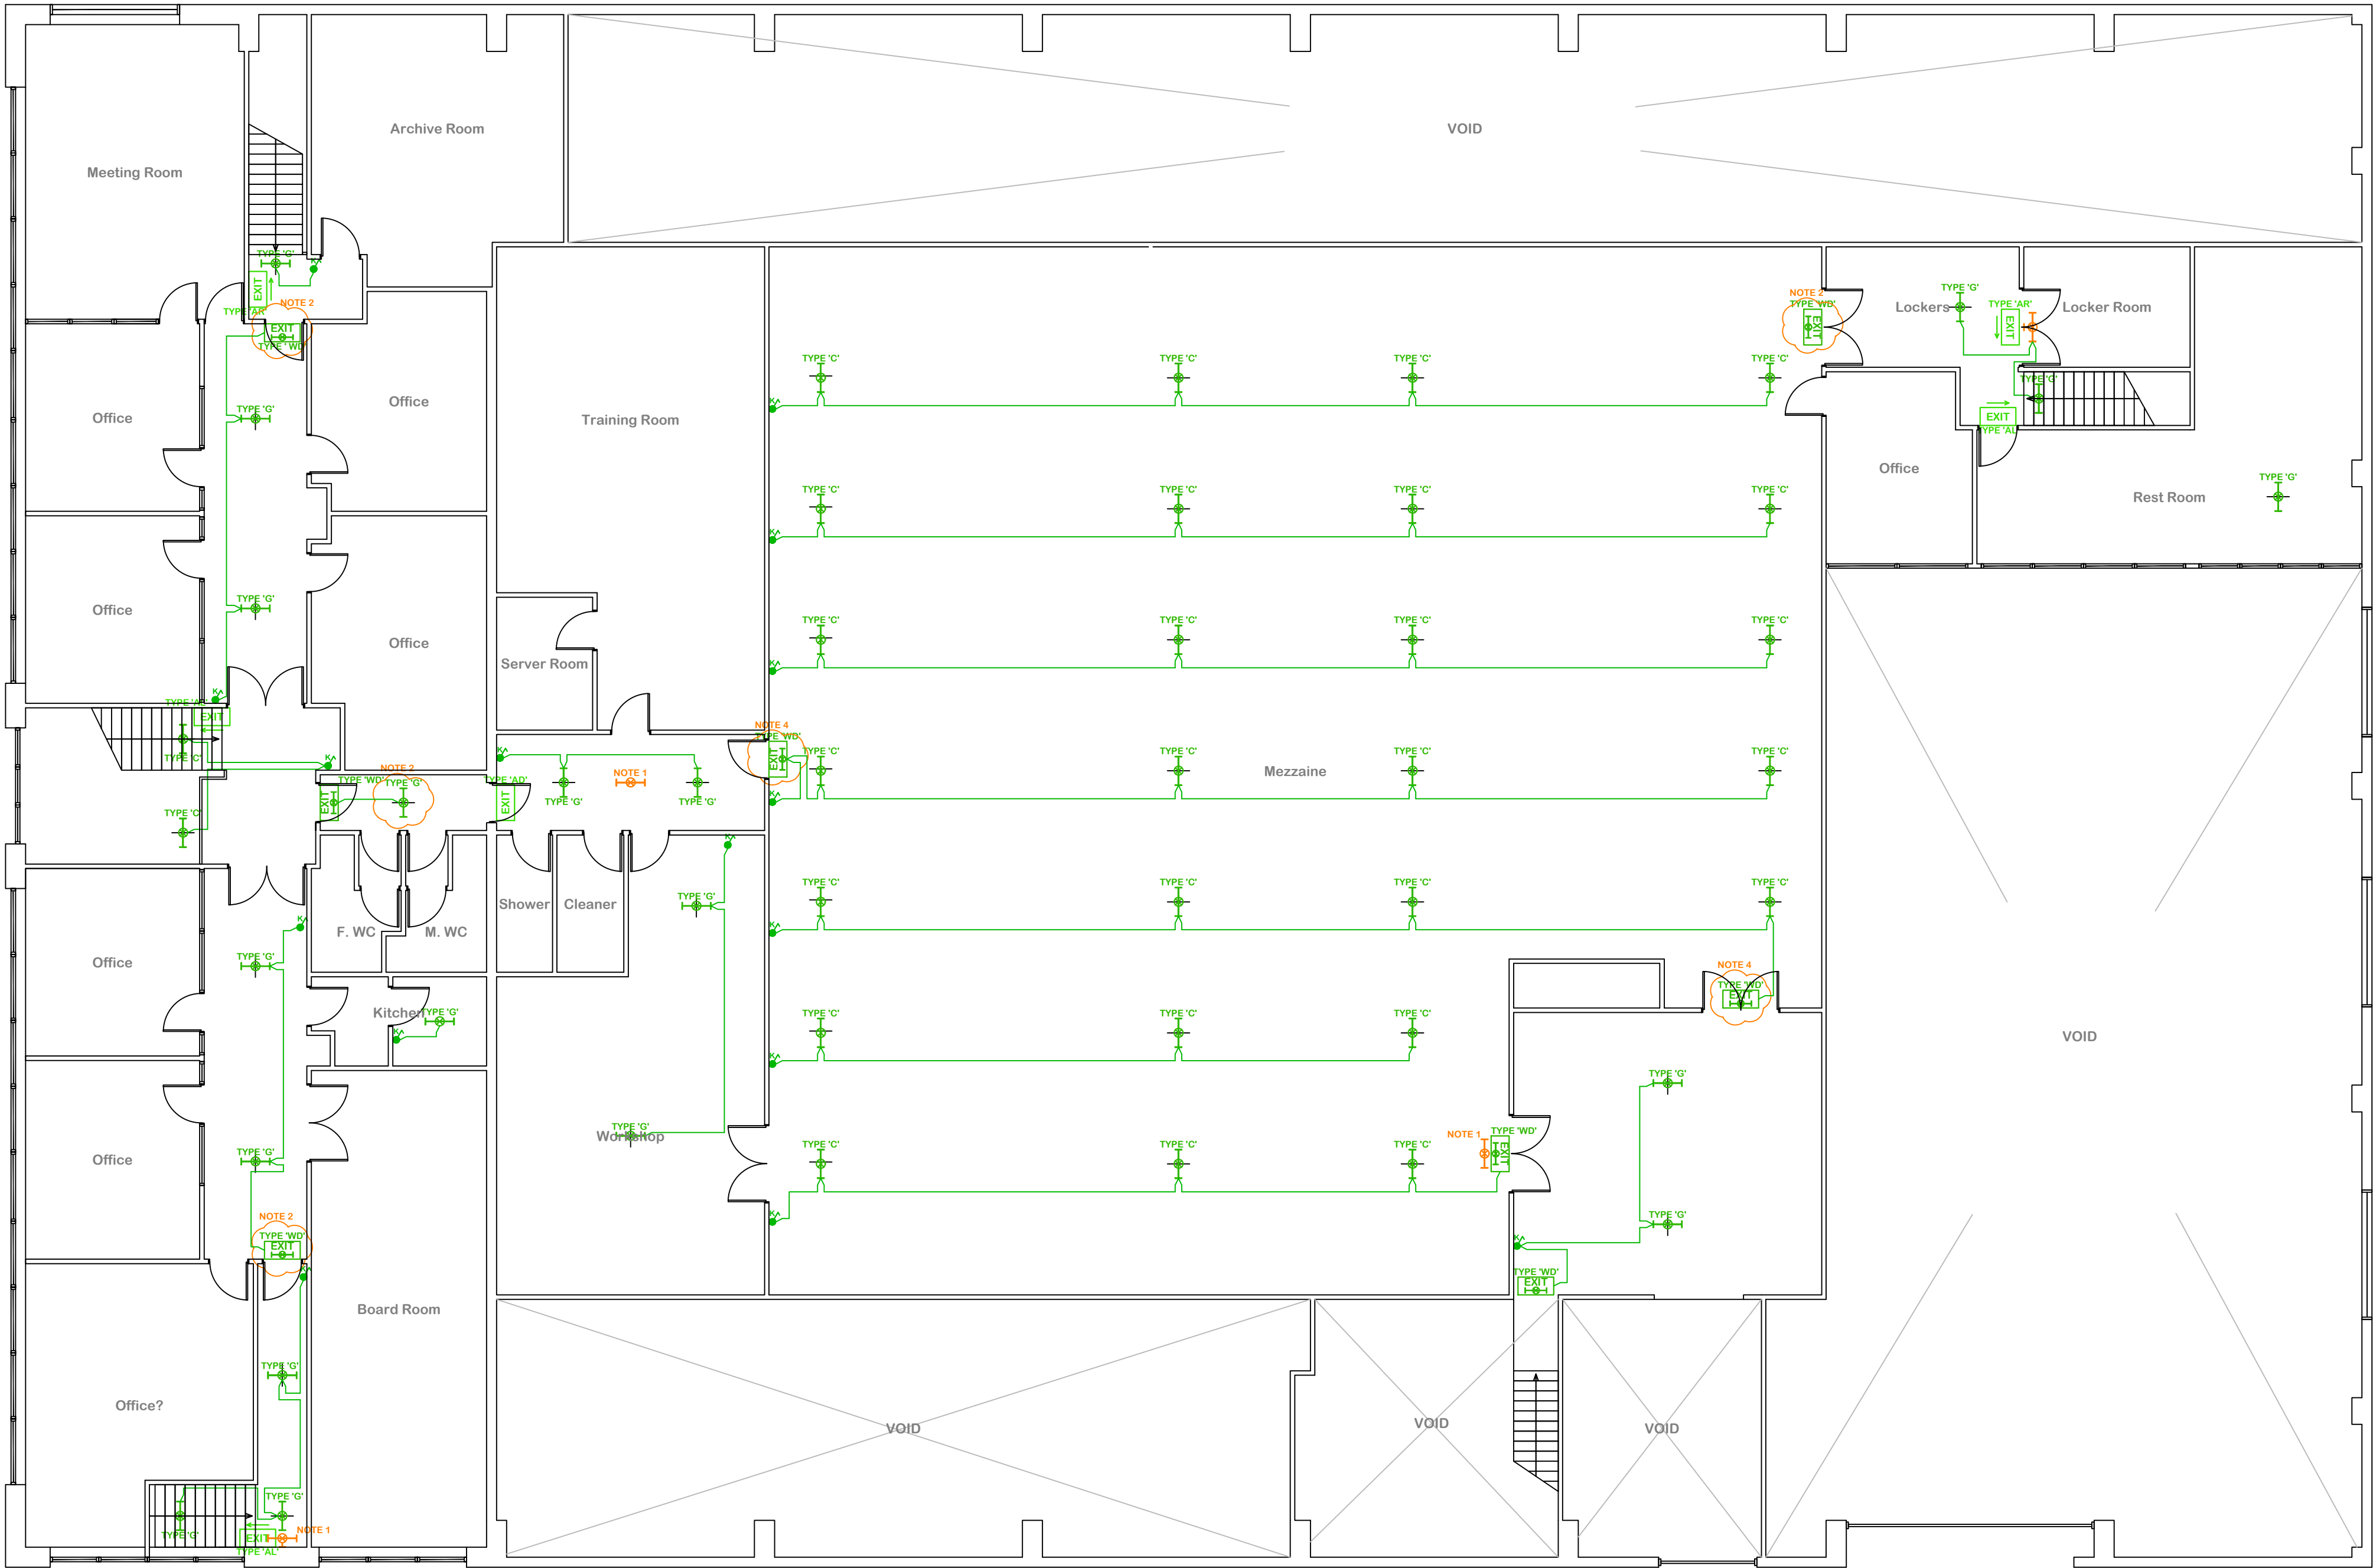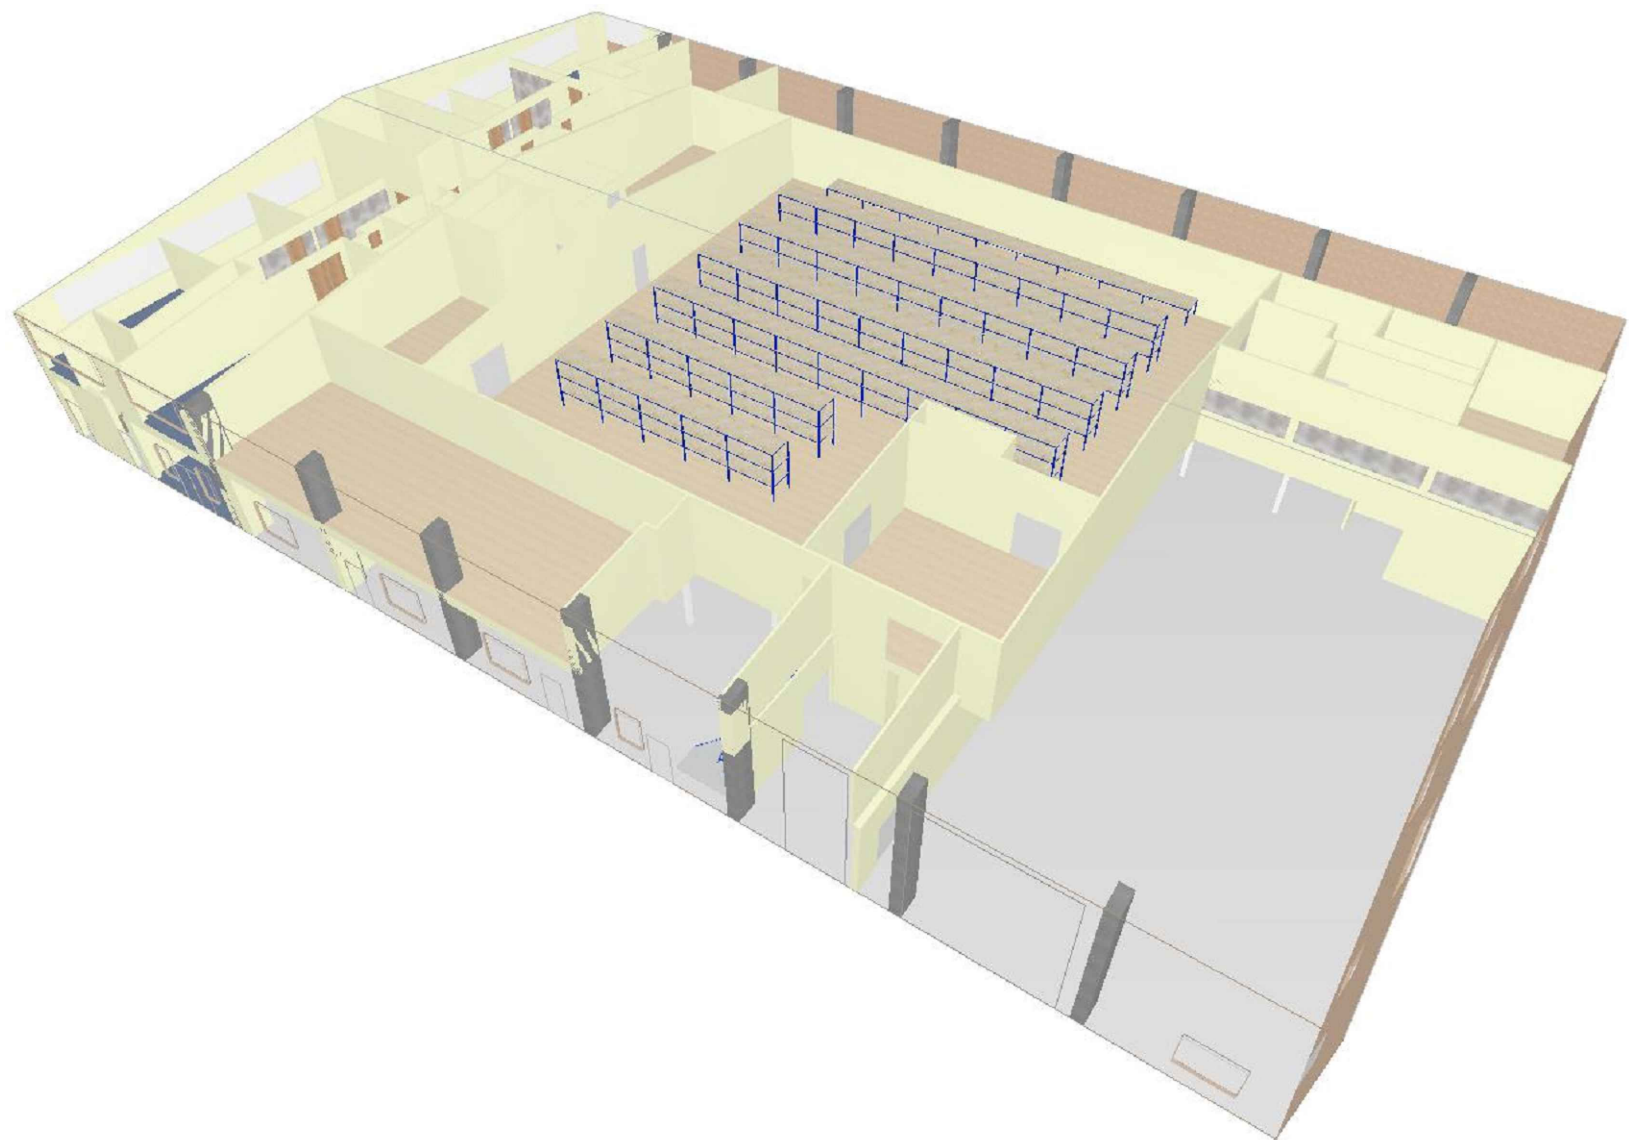

*** WARNING ***

The Emergency Lighting design as detailed on this drawing has been developed to achieve the minimum illumination levels as defined within BS5266:Part 1:2011, independent of the normal mains electricity supply.

The design as depicted, has been based on specific emergency lighting equipment as detailed in the accompanying documentation.

The use of alternative equipment will invalidate the design as shown together with the compliance with the current British Standards.

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED
DO NOT SCALE FROM THIS DRAWING

A1

© This drawing and/or design is the property of 'LIFE SAFETY SYSTEMS' and shall not be reproduced or copied in the whole or part in any way or conveyed to a third party without the owner's written permission.

NOTES:

Revision	Description	Date	Checked
----------	-------------	------	---------

AMENDMENT RECORD



DESIGN & DRAFTING SERVICES

4 HERMITAGE CLOSE THREE LEGGED CROSS
WIMBORNE DORSET BH21 6QA
Tel: 07835 742200
Email: autocad_drawings@btinternet.com

Project:

Test Link Services Ltd
Factory Road
Upton
Poole
Dorset
BH16 5SJ

Title:

Proposed
Emergency Lighting Upgrade

FIRST FLOOR

Drawn By: ISW Date: FEB 16

Checked By: Date:

Scale @ A1: 1:100 Date: FEB 16

Drawing Number:

SAMPLE/2016/02/EM101

Revision: